
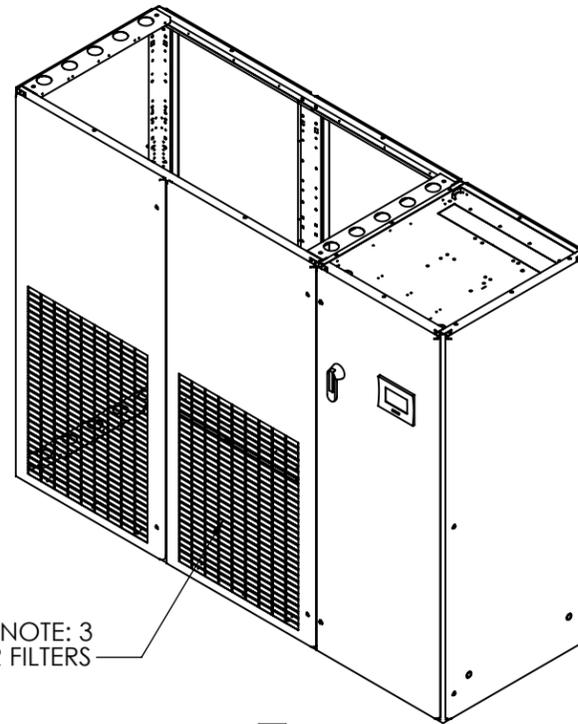


DATE PRINTED: 6/10/2016



REVISIONS			
REV.	DESCRIPTION	DATE	APPROVED
-	-	-	-
-	-	-	-

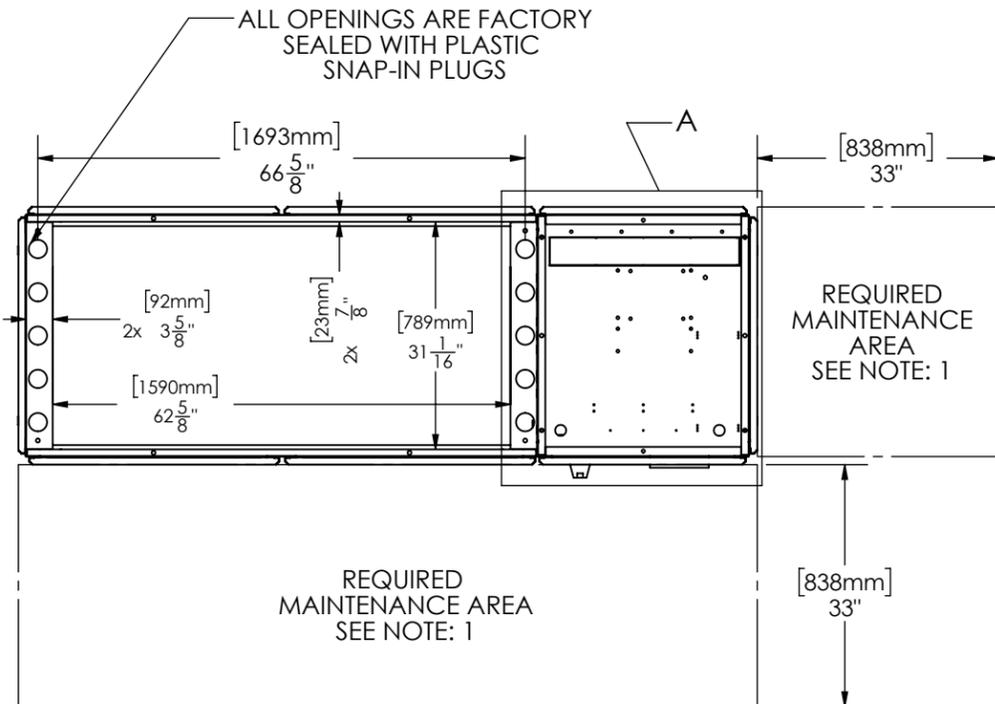

**PIPING CONNECTION SIZES**

FREE COOLED PFU XXX
A = HOT WATER REHEAT Ø 7/8" - RETURN
B = HOT WATER REHEAT Ø 7/8" - SUPPLY
C = GLYCOL SUPPLY Ø 2 1/8"
D = CONDENSATE DRAIN Ø 3/4"
E = GLYCOL RETURN Ø 2 1/8"
F = HUMIDIFIER WATER SUPPLY Ø 1/4"

**NOTES:**

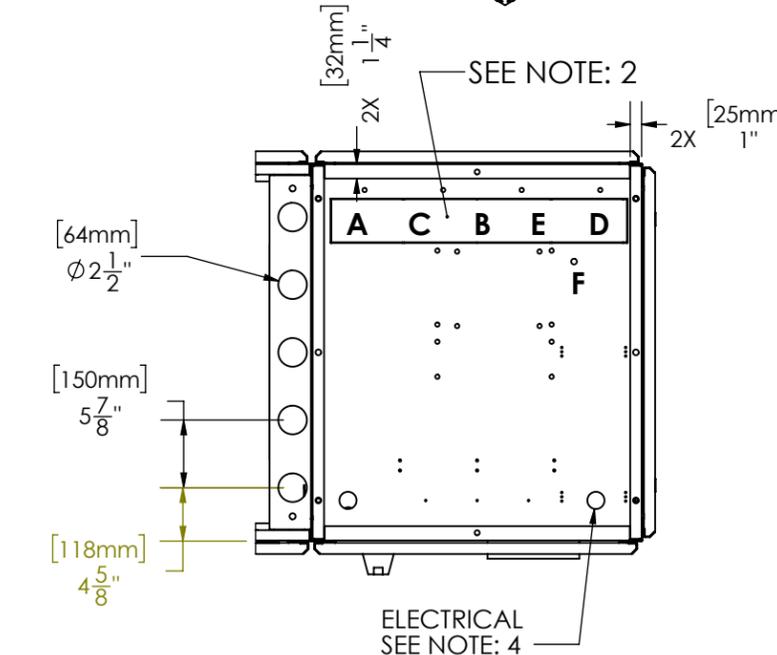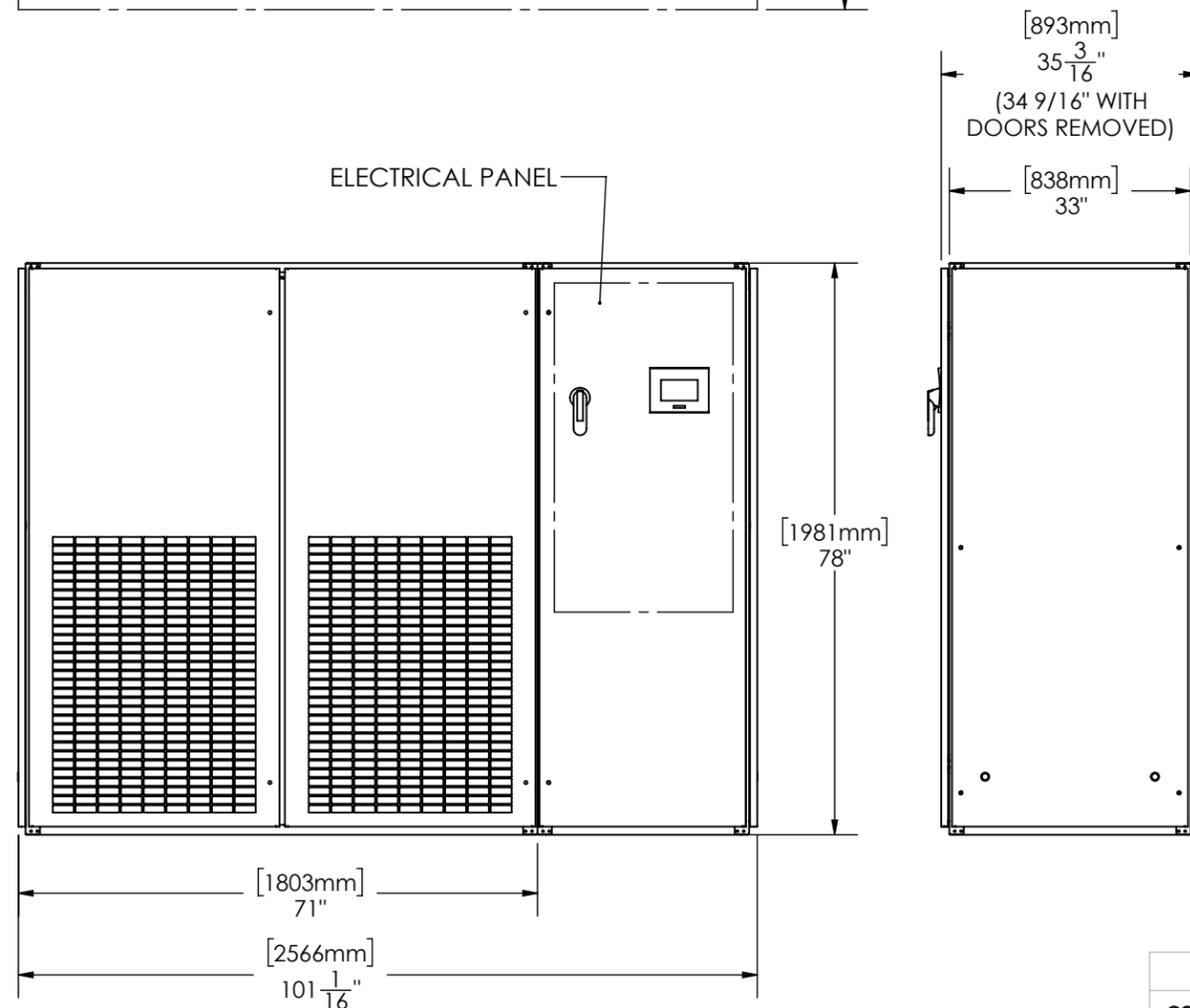

**NOTES:**

- FANS, MOTORS AND ELECTRICAL PANEL ARE FRONT SERVICEABLE. VALVES, PIPING AND COMPRESSORS ARE SIDE SERVICE.
- ALL PIPING THROUGH TOP PIPING HOLES UNLESS SPECIFIED AT TIME OF ORDER. UNUSED HOLES WILL BE FACTORY PLUGGED.
- FILTERS. QTY=4, 30X20X2
- ELECTRICAL WIRING THROUGH TOP OR BOTTOM HOLES. ALL ENTRY POINTS MUST BE SEALED BY CONTRACTOR.
- ESTIMATED DRY WEIGHT  
PFU057 TOTAL: 2400 LBS  
B SECTION (IF SPLIT UNIT): 770 LBS

DETAIL A  
SCALE 1 : 16

UNLESS OTHERWISE SPECIFIED  
DIMENSIONS ARE IN INCHES  
TOLERANCES:  
FRACTIONAL: ± 1/8  
ANGULAR: ± 0.5° BEND ± 2°  
DECIMAL  
XXX = ±.010  
XX = ±.020  
X = ±.030  
HOLE DIA. +.003/-0.000

BY		DATE
DRAWN	CL	2013-10-07
CHECKED	GB	2013-10-07
CNC PROGRAM		
FINISH:		
MATERIAL	THICKNESS	
N/A	N/A	

		FINAL ASSEMBLY	P-SERIES, UPFLOW
			PFU057
PART NAME		F-SIZE, PLUS B SUBMITTAL	
SIZE	DWG. NO.		
B	SPDU-F-FPB		
REV.	SEE TABLE		
BD	N/A	K	
SCALE: 1:20		SHEET 1 OF 1	

**CONFIDENTIAL:** THE COPYRIGHT OF THIS DOCUMENT IS RESERVED BY CLIMATEWORX. THIS DOCUMENT IS ISSUED ON THE CONDITION THAT IT IS NOT COPIED, REPRODUCED OR DISCLOSED TO ANY OTHER PARTY WITHOUT WRITTEN CONSENT OF CLIMATEWORX.